

FIRE EXTINGUISHER SIGNS

These designs comply to BS EN3 fire classes A, B and C.

Ensure your signs comply with ALL current legislation.

From January 1st 1997 all fire extinguishers must contain a red body. The emphasis being placed on the use of the equipment, rather than on the content of the equipment. An area of colour coding may still be used on the apparatus providing it is no greater than 5% of the area of the fire extinguisher. Use our range of signs to help you comply with both the safety signs and signals regulations and EN3/5.

All signs shown are available in 1mm rigid plastic, self adhesive vinyl or request rigid plastic with a self adhesive backing.



EN3 82 x 202



EN4 82 x 202



EN5 82 x 202



EN6 82 x 202



EN7 82 x 202



EN8 82 x 202



EN10 82 x 202



EN11 82 x 202



EN12 82 x 202



EN1 350 x 200 EN2 600 x 370 ENPG 125 x 90
(Pocket guides supplied in packs of 10s)



FI 48 300 x 200 FI 49 600 x 400 FIGP 125 x 90
(Pocket guides supplied in packs of 10s)



FICENT1
(800 x 700) Complete with 20 leaf binder for your fire drill records and a perspex wallet for your fire safety books.



ARM5



Fully colour coded signs are still acceptable to BS EN3 and may be used throughout the serviceable life of existing equipment only.




F150
100 x 250



F151
100 x 250



F152
100 x 250



F153
100 x 250



F154
100 x 250



F155
100 x 250



STAG2
Fire safety
Log Book



FIRE EQUIPMENT SIGNS



FI0 300 x 100
FI1 450 x 150



FI2 300 x 100



FI3 300 x 100



FI4 100 x 150
FI5 200 x 300
FI6 300 x 400



FI7 200 x 300
FI8 300 x 400



FI9 200 x 300
FI10 300 x 400



FI11 200 x 300
FI12 300 x 400



FI13 200 x 300
FI14 300 x 400



FI16 300 x 100



FI17 300 x 100



FI18 300 x 100



FI20 200 x 200



FI21 200 x 200



FI22 200 x 200



FI23 200 x 200



FI24 200 x 200



FI26 250 x 150



FI27 250 x 150



FI28 250 x 150



FI29 250 x 150



FI30 350 x 150
FI31 400 x 200



FI33 200 x 200



FI34 200 x 200



FI35 200 x 150



FI36 200 x 150



FI37 200 x 150



FI38 200 x 150



FI41 200 x 150



FI42 200 x 150



FI43 200 x 150



FI44 200 x 150




FI39
100 x 250



FI45 200 x 150



FI46 200 x 150



FI71 300 x 100



FI56 200 x 250



FI57 200 x 250

**CUSTOM FIRE
EQUIPMENT
SIGNS
PAGE 38**

PROJECTING SIGNS



PRO1 200 x 200



PRO2 200 x 200



PRO3 200 x 200



PRO4 200 x 200



PRO5 200 x 200

Printed double sided on 3mm foamex, this range indicates the position of emergency equipment quickly and efficiently. Size shown indicates the face size.

LABELS ON A ROLL



FDR8 100 x 100



FDR9 100 x 100



FDR10 100 x 100






FDR11 100 x 100

Supplied 100 labels on a roll, cost effective and easy to use ideal for large identification schemes to comply with regulations.

FIRE DOOR SIGNS

Manufactured from 1.2mm thick solid brass or satin anodised aluminium complete with fixing holes.

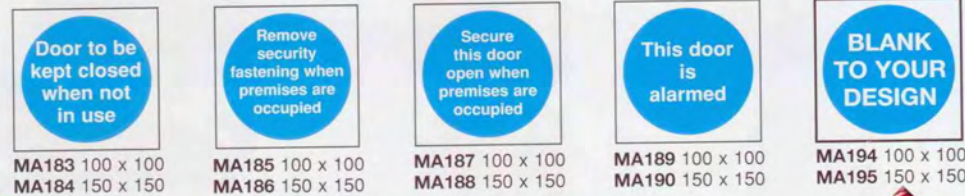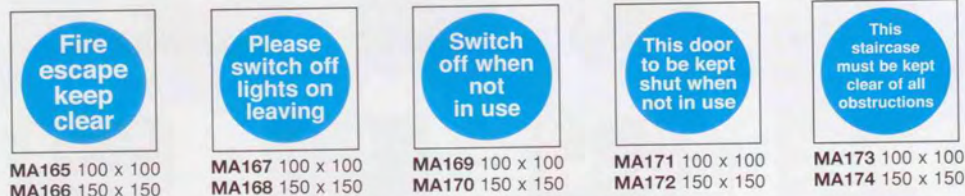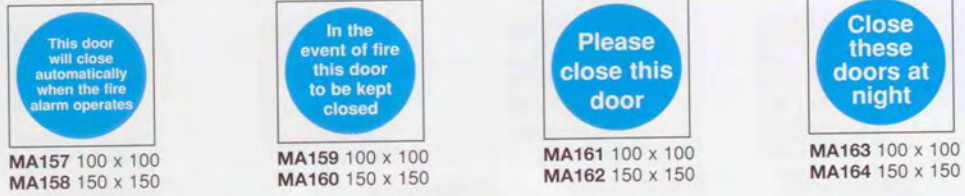

NEW



**MORE
BRILLE
SIGNS ON
PAGE 30**

These designs shown to the right interpret the EEC regulations (however either design is acceptable)



Self adhesive labels supplied on the roll. 100 labels per roll. Each label 100 x 100mm

! Fire door keep shut

MA196 35 x 400 (sav only)

Fire action

IF YOU DISCOVER A FIRE:-

- a) Sound the alarm
- b) Dial [] to call the fire brigade
- c) If possible tackle the fire using the appliances provided but do not endanger yourself or others in doing so.

IF YOU HEAR THE FIRE ALARM:-

- d) Leave the building by the nearest available exit:-
- e) Close all the doors behind you.
- f) Report to person in charge of assembly point:-



- g) Do not stop to collect personal belongings. Do not use the lift. Never re-enter the building for any reason unless authorised to do so. Do not take risks.

FI61 200 x 300
FI62 400 x 600

Fire action

IF YOU DISCOVER A FIRE:-

- a) Immediately operate the nearest fire alarm call point
- b) Attempt to tackle the fire using the appliances provided but do not take personal risks.

IF YOU HEAR THE FIRE ALARM:-

- c) Leave the building by the nearest available exit:-
- d) Close all the doors behind you.
- e) Report to person in charge of assembly point:-

DO NOT STOP TO COLLECT PERSONAL BELONGINGS. Do not use the lift. Never re-enter the building for any reason unless authorised to do so. Do not take risks.

FI63 200 x 300

Fire action

IF YOU DISCOVER A FIRE:-

- a) Sound the alarm
- b) Dial [] to call the fire brigade
- c) If possible tackle the fire using the appliances provided but do not endanger yourself or others in doing so.

IF YOU HEAR THE FIRE ALARM:-

- d) Leave the building by the nearest available exit:-
- e) Close all the doors behind you.
- f) Report to person in charge of assembly point:-

DO NOT STOP TO COLLECT PERSONAL BELONGINGS. Do not use the lift. Never re-enter the building for any reason unless authorised to do so. Do not take risks.

FI64 200 x 300

Fire action

FIRE INSTRUCTIONS FOR STAFF

IF YOU DISCOVER A FIRE:-

- a) Ensure that no-one is in immediate danger
- b) Raise the alarm by sounding the nearest fire alarm
- c) Attempt to tackle the fire with the correct appliance unless the fire is beyond effective control
- d) If the fire is beyond control evacuate the building clearing all main doors as possible

IF YOU HEAR THE FIRE ALARM:-

- e) Staff should if necessary see that persons are evacuated from the building and a roll call taken
- f) A designated person should call the fire brigade in accordance with the relevant instructions. Ensure the fire brigade is called to every fire or suspicion of fire.

FI65 200 x 300

In case of fire break glass

Fire action

IF YOU DISCOVER A FIRE:-

- a) Sound the alarm
- b) Dial [] to call the fire brigade
- c) If possible tackle the fire using the appliances provided but do not endanger yourself or others in doing so.

IF YOU HEAR THE FIRE ALARM:-

- d) Leave the building by the nearest available exit:-
- e) Close all the doors behind you.
- f) Report to person in charge of assembly point:-

DO NOT STOP TO COLLECT PERSONAL BELONGINGS. Do not use the lift. Never re-enter the building for any reason unless authorised to do so. Do not take risks.

FI66 200 x 300
FI67 400 x 600

In case of fire

Do not use lift

Use the stairs

FI70 200 x 300

Fire action

Operate the nearest fire alarm

Leave the building by the nearest available exit

Report to the person in charge of the assembly point at:-

Do not use lift. Do not re-enter the building until authorised to do so

FI68 200 x 300

Fire action

What you should do:

IF YOU DISCOVER A FIRE:-

1. Sound the alarm
2. Attempt to tackle the fire with the correct appliance unless the fire is beyond effective control
3. If the fire is beyond control evacuate the building clearing all main doors as possible

IF YOU HEAR THE FIRE ALARM:-

4. Staff should if necessary see that persons are evacuated from the building and a roll call taken
5. A designated person should call the fire brigade in accordance with the relevant instructions. Ensure the fire brigade is called to every fire or suspicion of fire.

DO NOT USE THE LIFT.

DO NOT RE-ENTER THE BUILDING FOR ANY REASON UNLESS AUTHORIZED TO DO SO.

FI69 200 x 300



MAST1 for use with GUN1

GUN1 accepts MAST1

Fire action **Action en cas d'incendie** **Verhalten bei Feuer**

IF YOU DISCOVER A FIRE:-

- a) Sound the alarm
- b) Dial [] to call the fire brigade
- c) If possible tackle the fire using the appliances provided but do not endanger yourself or others in doing so.

IF YOU HEAR THE FIRE ALARM:-

- d) Leave the building by the nearest available exit:-
- e) Close all the doors behind you.
- f) Report to person in charge of assembly point:-

DO NOT STOP TO COLLECT PERSONAL BELONGINGS. Do not use the lift. Never re-enter the building for any reason unless authorised to do so. Do not take risks.

FI171 400 x 300 (English, French and German)



Fire action signs displaying pictorial symbols comply to the BS5499 designs.

A comprehensive fire exit scheme can be undermined through the lack of an accurate fire procedure.

Fire Action Notices provide essential, detailed information and should form part of a comprehensive fire exit and evacuation process.

If your requirements cannot be met from our standard range please contact our sales office for prices on specialist notices.



PHOTOLUMINESCENT FIRE ACTION NOTICES

Fire action

IF YOU DISCOVER A FIRE:-

- a) Sound the alarm
- b) Dial [] to call the fire brigade
- c) If possible tackle the fire using the appliances provided but do not endanger yourself or others in doing so.

IF YOU HEAR THE FIRE ALARM:-

- d) Leave the building by the nearest available exit:-
- e) Close all the doors behind you.
- f) Report to person in charge of assembly point:-

DO NOT STOP TO COLLECT PERSONAL BELONGINGS. Do not use the lift. Never re-enter the building for any reason unless authorised to do so. Do not take risks.

PH26 200 x 300

Fire action

IF YOU DISCOVER A FIRE:-

- a) Immediately operate the nearest fire alarm call point
- b) Attempt to tackle the fire using the appliances provided but do not take personal risks.

IF YOU HEAR THE FIRE ALARM:-

- c) Leave the building by the nearest available exit:-
- d) Close all the doors behind you.
- e) Report to person in charge of assembly point:-

DO NOT STOP TO COLLECT PERSONAL BELONGINGS. Do not use the lift. Never re-enter the building for any reason unless authorised to do so. Do not take risks.

PH27 200 x 300

Fire action

Operate the nearest fire alarm

Leave the building by the nearest available exit

Report to the person in charge of the assembly point at:-

Do not use lift. Do not re-enter the building until authorised to do so

PH237 200 x 300

Fire action **Action en cas d'incendie** **Verhalten bei Feuer**

IF YOU DISCOVER A FIRE:-

- a) Sound the alarm
- b) Dial [] to call the fire brigade
- c) If possible tackle the fire using the appliances provided but do not endanger yourself or others in doing so.

IF YOU HEAR THE FIRE ALARM:-

- d) Leave the building by the nearest available exit:-
- e) Close all the doors behind you.
- f) Report to person in charge of assembly point:-

DO NOT STOP TO COLLECT PERSONAL BELONGINGS. Do not use the lift. Never re-enter the building for any reason unless authorised to do so. Do not take risks.

PH296 400 x 300 (English, French and German)

MORE PHOTO-LUMINESCENT SIGNS ON PAGE 37

BRITISH STANDARD FIRE EXIT




All fire exit signs on this page conform to The Safety Signs and Signals Regulations 1996 which require all Safety, Health, Emergency Escape and Fire Equipment signs to include a pictorial symbol.

All employers must comply! It's the law!

These fire exit signs comply to BS5499 Part 4 and 5, 2000.

All signs are available in 1mm rigid plastic, self adhesive vinyl or rigid plastic with self adhesive backing.

Signs marked with the following symbol  must be used in conjunction with the running man symbol.



SA1 400 x 150
SA2 600 x 200



SA3 400 x 150
SA4 600 x 200



SA5 400 x 150
SA6 600 x 200



SA7 400 x 150
SA8 600 x 200



SA9 400 x 150
SA10 600 x 200



SA11 400 x 150
SA12 600 x 200



SA13 400 x 150
SA14 600 x 200



SA15 400 x 150
SA16 600 x 200



SA17 150 x 150
SA18 200 x 200



SA19 150 x 150
SA20 200 x 200




SA23 150 x 150
SA24 200 x 200



SA21 750 x 150



SA22 750 x 150



SA25 400 x 125
SA26 600 x 150



SA27 300 x 150
SA28 400 x 200



SA27L 300 x 150
SA28L 400 x 200



SA29 125 x 125
SA30 150 x 150
SA31 200 x 200



SA32 125 x 125
SA33 150 x 150
SA34 200 x 200



SA35 400 x 150
SA36 600 x 200



SA37 400 x 150
SA38 600 x 200



SA39 400 x 150
SA40 600 x 200



SA41 400 x 150
SA42 600 x 200



SA43 400 x 150
SA44 600 x 200



SA45 400 x 150
SA46 600 x 200



SA47 400 x 150
SA48 600 x 200




SA49 400 x 150
SA50 600 x 200



SA51 300 x 150
SA52 400 x 200



SA51L 300 x 150
SA52L 400 x 200



SA58 450 x 200
SA59 600 x 200



SA60 300 x 250
SA61 600 x 400



SA62 450 x 200
SA63 600 x 250



SA119 450 x 200
SA120 600 x 200



HEALTH & TECHNICAL MEMORANDUM 65

These signs are designed to meet The Hospital Technical Memorandum 65 (Sign Guide 2), and enhance the original BS5499 pictograms with the addition of flames.

Produced for hospitals and healthcare facilities. Those responsible for signing such establishments are strongly advised to use these signs where practical.



HTM1 400 X 150
HTM2 600 X 200



HTM3 400 X 150
HTM4 600 X 200



HTM5 400 X 150
HTM6 600 X 200



HTM7 400 X 150
HTM8 600 X 200



HTM9 300 X 150
HTM10 400 X 200



EC DIRECTIVE SIGNS



EC1 400 X 150
EC2 600 X 200



EC3 400 X 150
EC4 600 X 200



EC5 400 X 150
EC6 600 X 200



EC7 400 X 150
EC8 600 X 200



EC9 400 X 150
EC10 600 X 200



EC11 400 X 150
EC12 600 X 200



EC13 400 X 150
EC14 600 X 200



EC15 400 X 150
EC16 600 X 200



EC17 400 X 150
EC18 600 X 200



EC19 400 X 150
EC20 600 X 200



EC21 400 X 150
EC22 600 X 200



EC23 400 X 150
EC24 600 X 200

These signs comply to the EEC Council Directive 92/58/EEC.

All signs on this page comply to the Safety Signs and Signals regulations 1996.

Mixing of British Standard and European Designs is not advised.



BRILLE FIRE EXIT SIGNS



TAC 21 450x150



TAC 22 450x150



TAC 23 450x150



TAC 24 450x150



TAC 26 450x125



TAC 27 450x125



TAC 25 300x150



TAC 28 300x150

Ensure you comply to the Part iii of the Disability Discrimination Act, regulations 1995 which came into effect, 1st October 2004.

DOUBLE SIDED HANGING SIGNS



EC66 600 x 200
EC67 1200 x 400



EC68 600 x 200



EC69 600 x 200
EC70 1200 x 400



EC71 400 x 200



HA8 600 x 450



HA4 600 x 200
HA9 1200 x 400



HA5 600 x 200



HA6 600 x 200
HA10 1200 x 400



HA7 400 x 200

Hanging signs and frames give a prestigious look to your emergency fire exits. See the bottom of the page for a choice of frames.

REFUGE GUIDANCE SIGNS



RG1 400 X 150
RG7 600 X 200



RG2 400 X 150
RG8 600 X 200



RG3 400 X 150
RG9 600 X 200



RG6 400 X 150
RG10 600 X 200



RG4 200 X 300



RG5 200 X 300

Use these signs to help comply to the new DDA Regulations.

SUSPENSION SIGN FRAMES

Aluminium Frames

- SUSP5 400 x 150
- SUSP6 600 x 200
- SUSP7 200 x 300

Use with double sided signs



Plastic Frames

- SUSP2 600 x 200
- SUSP4 400 x 150 (frame only)

Shown with sign for illustrative purposes. For use with double sided signs.



Step 1
Choose the size of frame to suit the signs you require (frames shown to left)



Step 2
Place your signs back to back and insert into the top of the SUSP frame

Step 3
Select your required method of hanging from the fixings shown on page 43.



ASSEMBLY POINT SIGNS



SA53 300 x 200
SA54 600 x 400
SA54A 600 x 400 (plate only)
(3mm Aluminium)
SA54AC 600 x 400 (with channel)
(3mm Aluminium)



SA55 300 x 200
SA56 600 x 400
Please specify the number or letter you require when ordering.



SA114 600 x 400

**CUSTOM
MADE
SPECIALS
ON PAGES
38-41**

SAFE CONDITION SIGNS



To advise, instruct and inform staff and visitors in the safe way to proceed.



SA77 300 x 100



SA86 300 x 100



SA95 300 x 100



SA118 300 x 100



SA90 200 x 300



SA117 200 x 300



SA91 200 x 300



SA113 200 x 300



SA115 200 x 300



SA64 100 x 150



SA65 100 x 150



SA66 100 x 150



SA67 100 x 150



SA68L 100 x 150



SA68R 100 x 150




SA92A 100 x 150




SA92 75 x 150




SA93 75 x 150




SA76 300 x 100




SA78 300 x 100




SA79 300 x 100




SA81 300 x 150



SA82 300 x 100
SA83 600 x 100



SA84 300 x 75



SA85 300 x 75

PROJECTING SIGNS

Printed double sided on 3mm foamex, this range indicates the position of emergency equipment quickly and efficiently. Size shown indicates the face size.



PRO6 400 x 600



PRO7 400 x 600



PRO8 200 x 200



PRO9 200 x 200



PRO10 200 x 200




PRO11 200 x 200



SA87 200 x 300



SA88 200 x 300



SA88A 200 x 300



SA89 200 x 300



SA80 300 x 100



SA96 300 x 100
SA97A 300 x 200



SA94A 100 x 100



SA94 300 x 100



SA94B 200 x 100



SA116 300 x 100

BLANK SAFE CONDITION SIGNS

Design your own safety signs. Following the 4 easy steps below:

STEP 1



TYPE & SIZE:
Safe Condition
200 x 300
SA300

STEP 2



SYMBOL:
First aid
SA300
+ CSS1

STEP 3



TEXT:
First aid station
located next to
warehouse
SA300
+ CSS1
+ TEXT

STEP 4



MATERIAL:
Self adhesive
vinyl (S)
SA300
+ CSS1
+ TEXT
+ SAV
That's it done!

SIZE AND STYLE



SA103 200 x 300
SA104 400 x 600



SA300 200 x 300
SA301 400 x 600



SA101 300 x 100
SA102 600 x 200



SA302 300 x 100
SA303 600 x 200

SYMBOLS



CSS1



CSS2



CSS3



CSS4



CSS5



CSS6



CSS7



CSS8



CSS9



CSS10



CSS11



CSS12



CSS13



CSS14

ACTION CENTRES



SACENT1
(800mm x 700mm)
Ideal for organising your statutory first aid obligations within the workplace. Has 20 leaves for displaying information and an acrylic holder for your accident book. First Aid box for 1-10 persons.



FICENT1
(800 x 700)
Complete with 20 leaf binder for your fire drill records and a perspex wallet for your fire safety books.



COCENT2
(800 x 700)
This COSHH centre will provide a central focus for crucial shared information. Supplied complete with 10 swing frames to hold 20 sheets and perspex wallet for your safety book.



All Action centres are manufactured from 5mm Foam PVC

BUDGET EMERGENCY LIGHTING



MAINTAINED

LU1M 355 x 125

Illuminated when mains lighting is turned on and provides 3hrs of emergency light in the event of mains failure. 8w

NON-MAINTAINED

LU1NM 355 x 125

Illuminated only in the event of mains failure battery pack gives 3hrs of emergency lighting. 8w

The legends below can be purchased to go with the above product.



COV 4 (EEC design) 590 x 115



COV 5 (British standard design) 460 x 120

EMERGENCY WAYFINDING LIGHT BOX



MAINTAINED

LU2M 390 x 190

Illuminated when mains lighting is turned on and provides 3hrs of emergency light in the event of mains failure. 8w


NON-MAINTAINED

LU2NM 390 x 190

Illuminated only in the event of mains failure battery pack gives 3hrs of emergency lighting. 8w

REPLACEMENT FASCIAS

Use these replacement fascias to fit your existing lightbox. State size and we will cut to size.

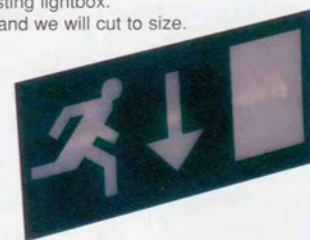

REPLAC1

Price Band A (fascia size) 300 x 100 to 400 x 100

REPLAC2

Price Band B (fascia size) 400 x 100 to 450 x 250

REPLAC3

Price Band C (fascia size) 450 x 250 to 600 x 300

Whether complimenting existing schemes or starting from afresh, our range of luminaries offers a cost effective answer to every situation. Supplied in both maintained and non-maintained formats.

FLUSH CEILING MOUNTED EMERGENCY LIGHTING



Recessed edge-light in white finish. Supplied with double sided screen printed legend pane. Requires a 50mm depth above ceiling tile or plasterboard and is fixed with 2 spring clips into a 330 x 135mm cut out.

3 HOUR MAINTAINED

LU3M 280 x 130

Sign is permanently illuminated and has a 3 hour battery back up case of mains failure.

3 HOUR NON-MAINTAINED

LU3NM 280 x 130

Sign is only illuminated in case of mains failure with a 3 hour battery back up.

Choose your required legend to go with the above product.



LU3MA (Double sided) 280 x 130 (fascia size) Viewing distance 30m



LU3MB (Double sided) 280 x 130 (fascia size) Viewing distance 30m

CEILING MOUNTED EMERGENCY LIGHTING

Ceiling mounted edge-light in white finish. Supplied with double sided screen printed legend panel with diamond polished edges. Fixed direct to ceiling the overall size is 290 x 440mm.

3 HOUR MAINTAINED

LU4M 280 x 130

Sign is permanently illuminated and has a 3 hour battery back - in case of mains failure.

3 HOUR NON-MAINTAINED

LU4NM 280 x 130

Sign is only illuminated in case of mains failure with a 3 hour battery back up.



Choose your required legend to go with the above product.



LU4MA (Double sided) 415 x 200 (fascia size) Viewing distance 36m



LU4MB (Double sided) 415 x 200 (fascia size) Viewing distance 36m

